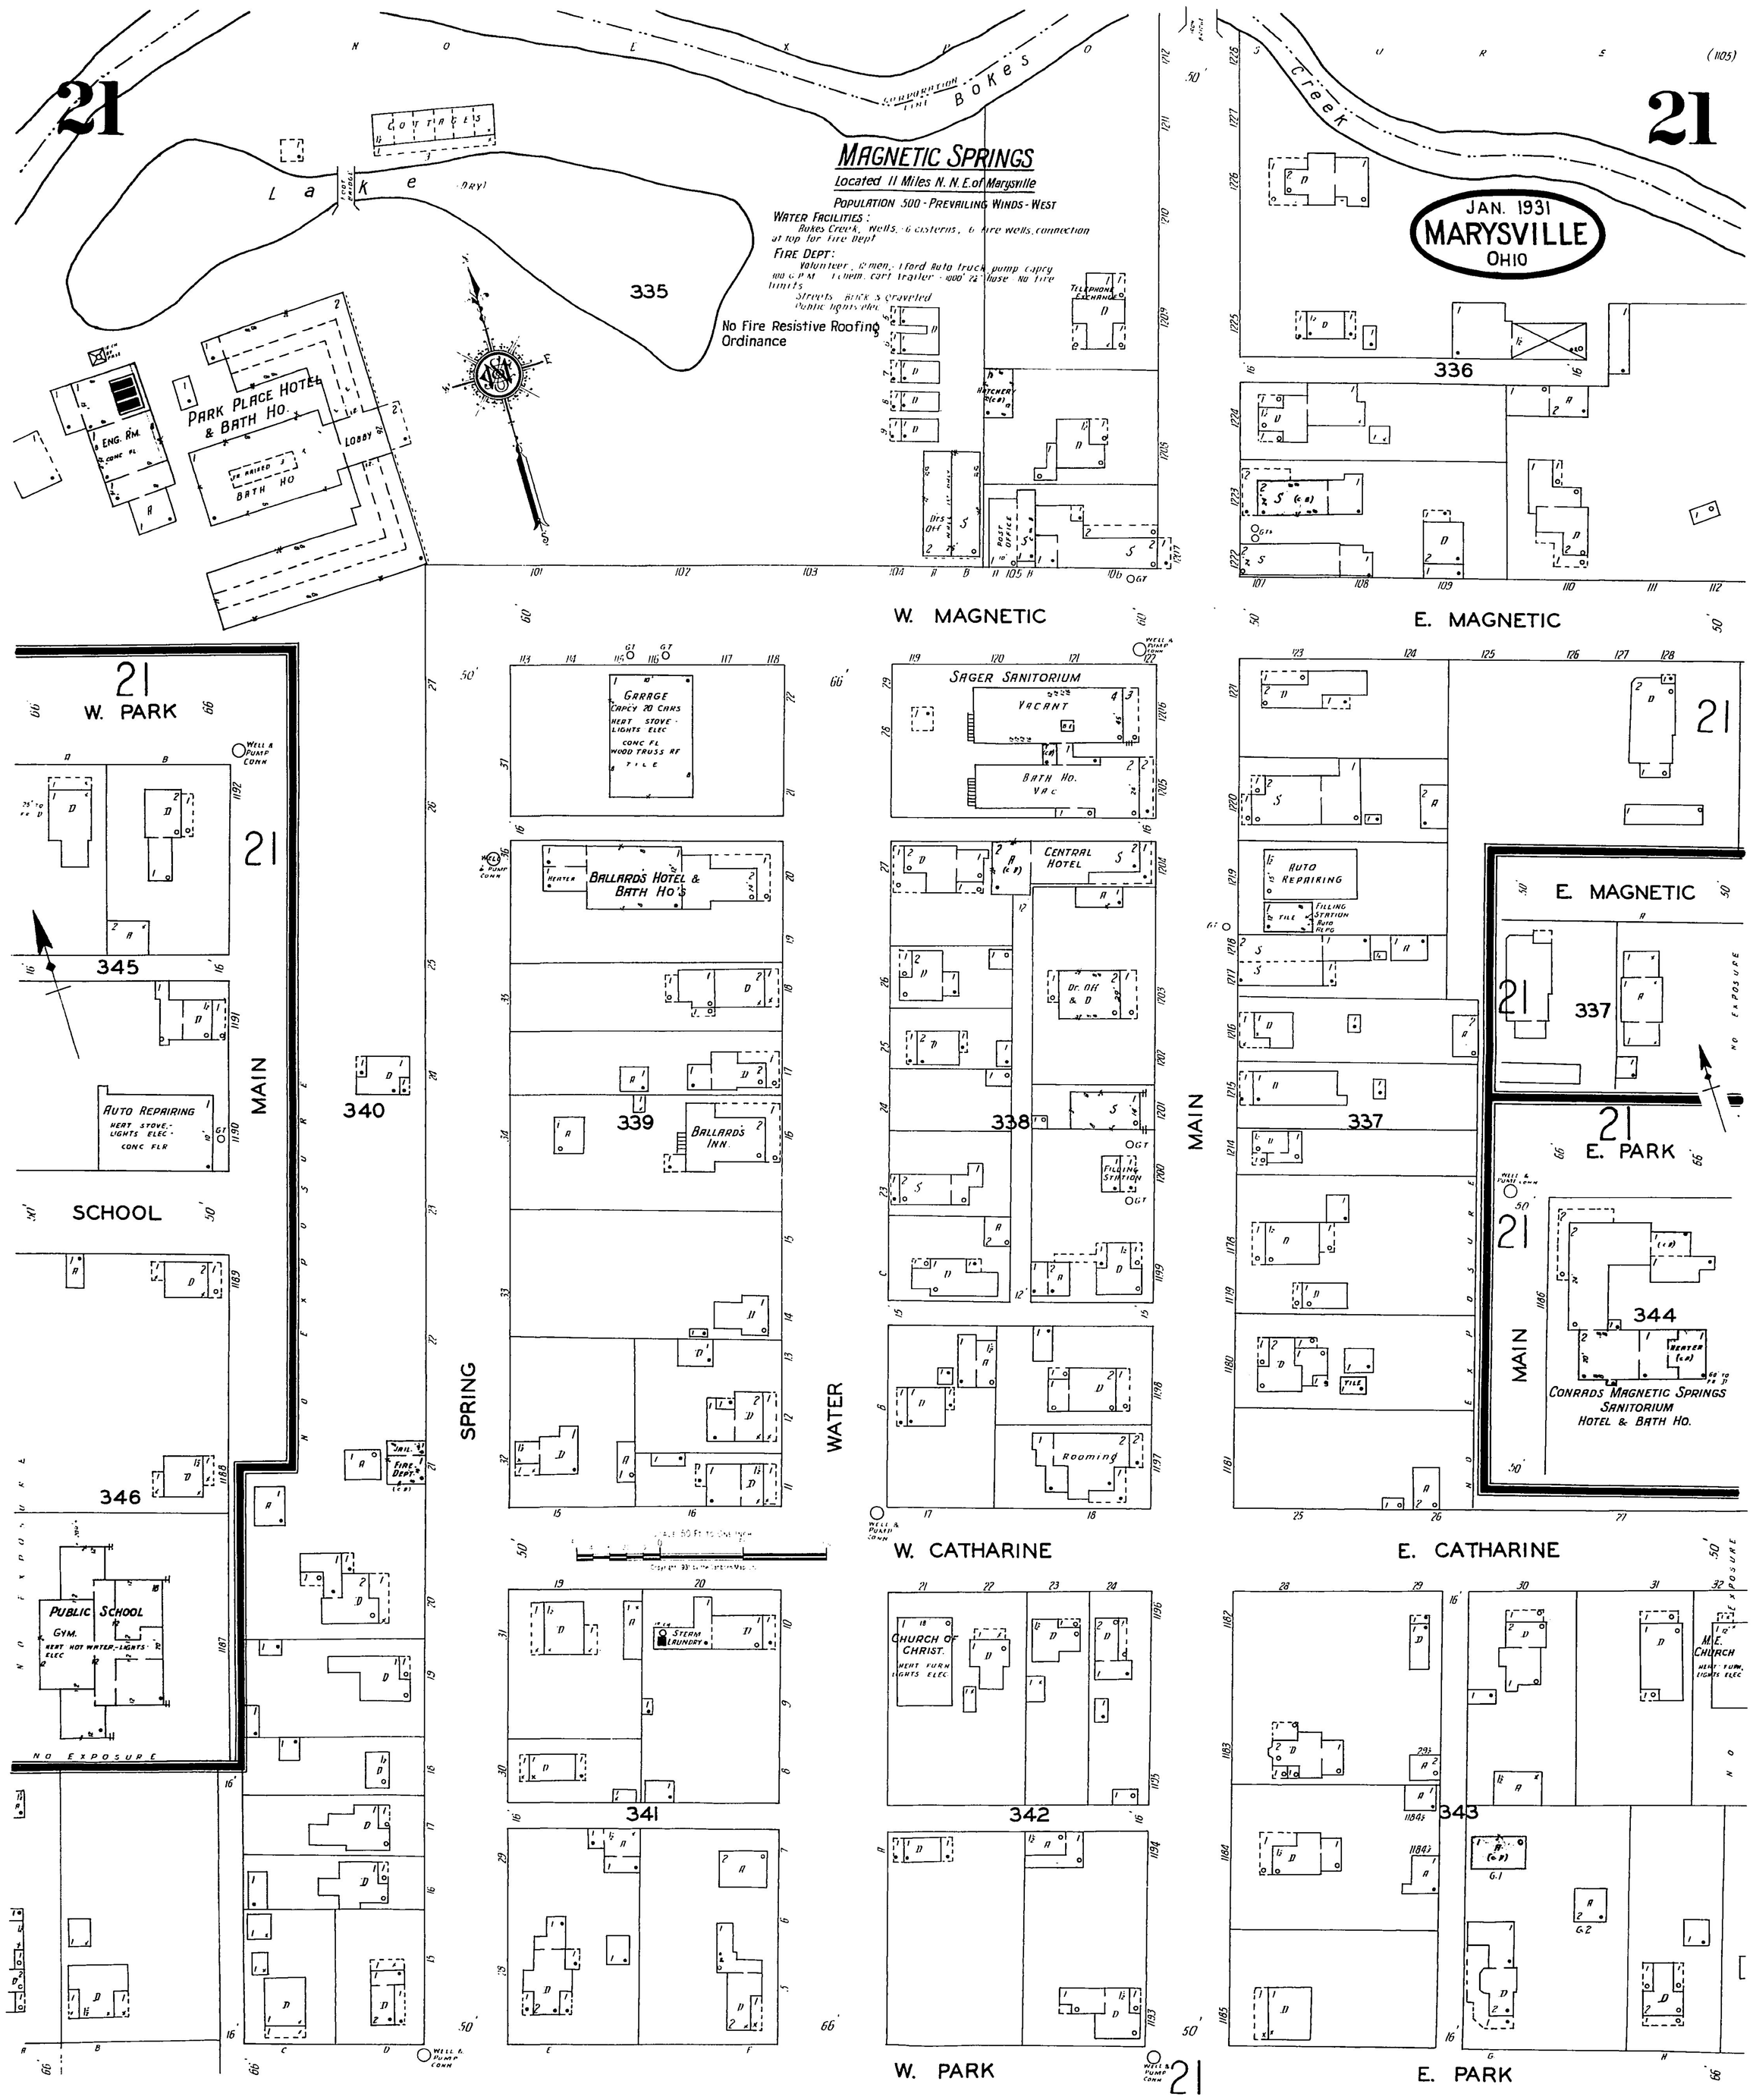
MAGNETIC SPRINGS
Located 11 Miles N. N. E. of Marysville
POPULATION 500 - PREVAILING WINDS - WEST
WATER FACILITIES:
Bokes Creek, Wells, 6 cisterns, 6 fire wells, connection at top for Fire Dept
FIRE DEPT:
Volunteer, 12 men, 1 Ford Auto truck pump capcy 400 G.P.M. 1 chem. cart trailer - 1000' 2½ hose. No fire limits
Streets Brick & gravelled
Public lights elec
No Fire Resistive Roofing Ordinance
JAN. 1931
MARYSVILLE
OHIO
Bokes Creek
Lake
PARK PLACE HOTEL & BATH HO.
BATH HO
LOBBY
ENG. RM.
335
336
W. MAGNETIC
E. MAGNETIC
W. PARK
E. PARK
SAGER SANITORIUM
VACANT
BATH HO.
GARAGE
CENTRAL HOTEL
BALLARDS HOTEL & BATH HO'S
BALLARDS INN
AUTO REPAIRING
FILLING STATION
Rooming
CONRADS MAGNETIC SPRINGS SANITORIUM HOTEL & BATH HO.
SPRING
WATER
MAIN
SCHOOL
PUBLIC SCHOOL
GYM.
FIRE DEPT.
JAIL
STEAM LAUNDRY
CHURCH OF CHRIST
M.E. CHURCH
NO EXPOSURE
W. CATHARINE
E. CATHARINE
340
339
338
337
344
345
346
341
342
343