



Private owner. Water works. Direct pressure system. Water from well 25 x 27" which is supplied from large spring. Emergency supply from Big Darby Creek by 1 1/2 Smith-Vale triplex double acting pump, size 8" x 10", power 1-50 HP, 3 phase electric motor, capacity 1280 gals. per min. Domestic supply water from well by 2 1/2 Smith-Vale triplex single acting pumps, size 7 x 10" capacity 1040 gals. per min. each, and 100 ft. double triplex pump, size 4" x 6" x 10" capacity 1000 gals. per min. About 4 1/2 miles of 4" o.d. x 6" mains. 138 miles laid 1883, 38 miles laid 1910. 18 double hydrs. Average daily consumption 150,000 gals. Domestic pressure 40 lbs. fire pressure 107 lbs.

1-volunteer company 12-men not paid.
1-Prospect auto chem. truck, carrying 2-30 gal.
chem. tanks, 1-mouse cart, 1-hand H. and L. truck,
1200 2 1/2" C.R.L. hose, 400' new, rest in good condn.
Fire alarm bell on engine No. 12-3-pd. chemicals
distd in town. Main sts. brick paved. Public lights-
electric arc. Grades nearly level. No fire limits.




SPECIALS

SPECIALS		M	
B	SHEET	Marysville Oil Products Co., Filling Station	1
Big Four Freight Station	2	Methodist Episcopal Church	1
C		Michaels, C., Saw Mill	1
Christian Church	2	Milford Center Grain Co.	1
Cloverdale Creamery	2	" " High School, The	1
Corporation Building	2	" " Lumber & Supply Co., 1	1
E		" " Milling Co.	1
Erb, L., F. Carriage Factory	3	" " Water Works and Transformer House	1
F		P	
Fire Department	2	Penn Line Passenger Station	1
First Baptist Church	1	Post Office	1
I		Presbyterian Church	1
I. O. O. F. Hall	2	R	
K		Richter Hotel	1
Kiser & Hoe Canning Co., The	3	S	
		Second Heart R. C. Church	1
		Sacred Baptist Church	1

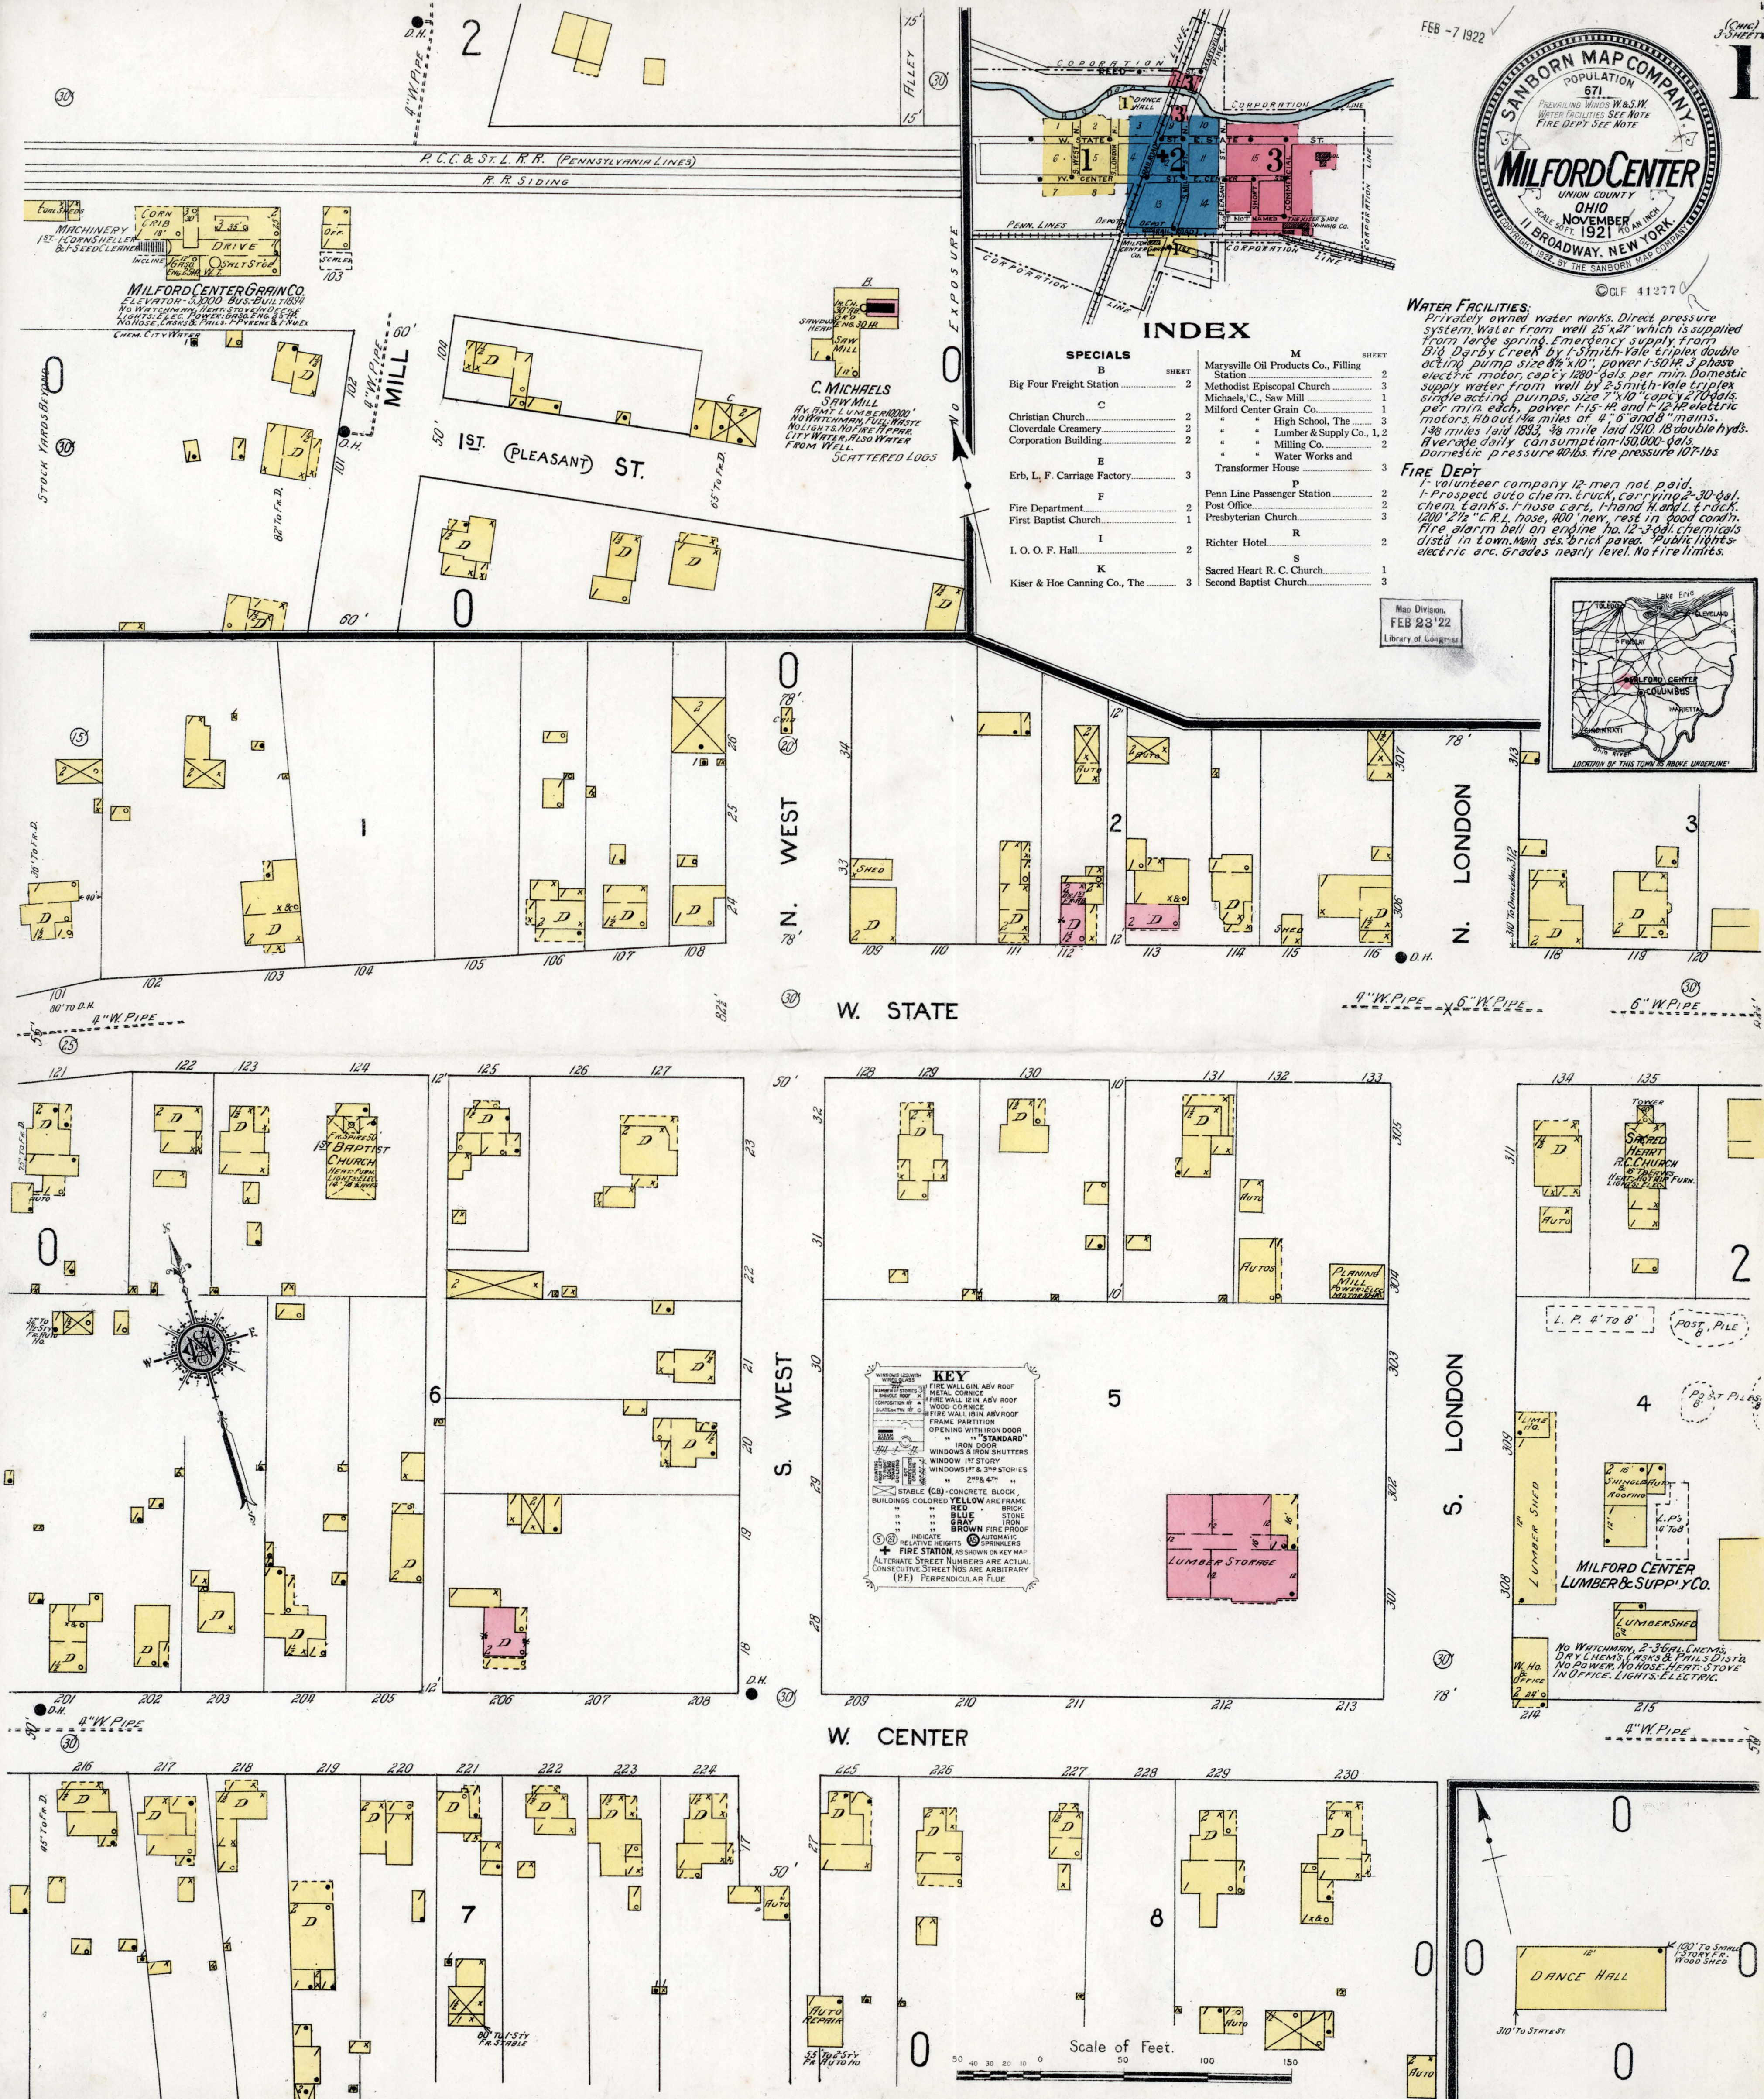

N. PLEASANT

S. PLEASANT

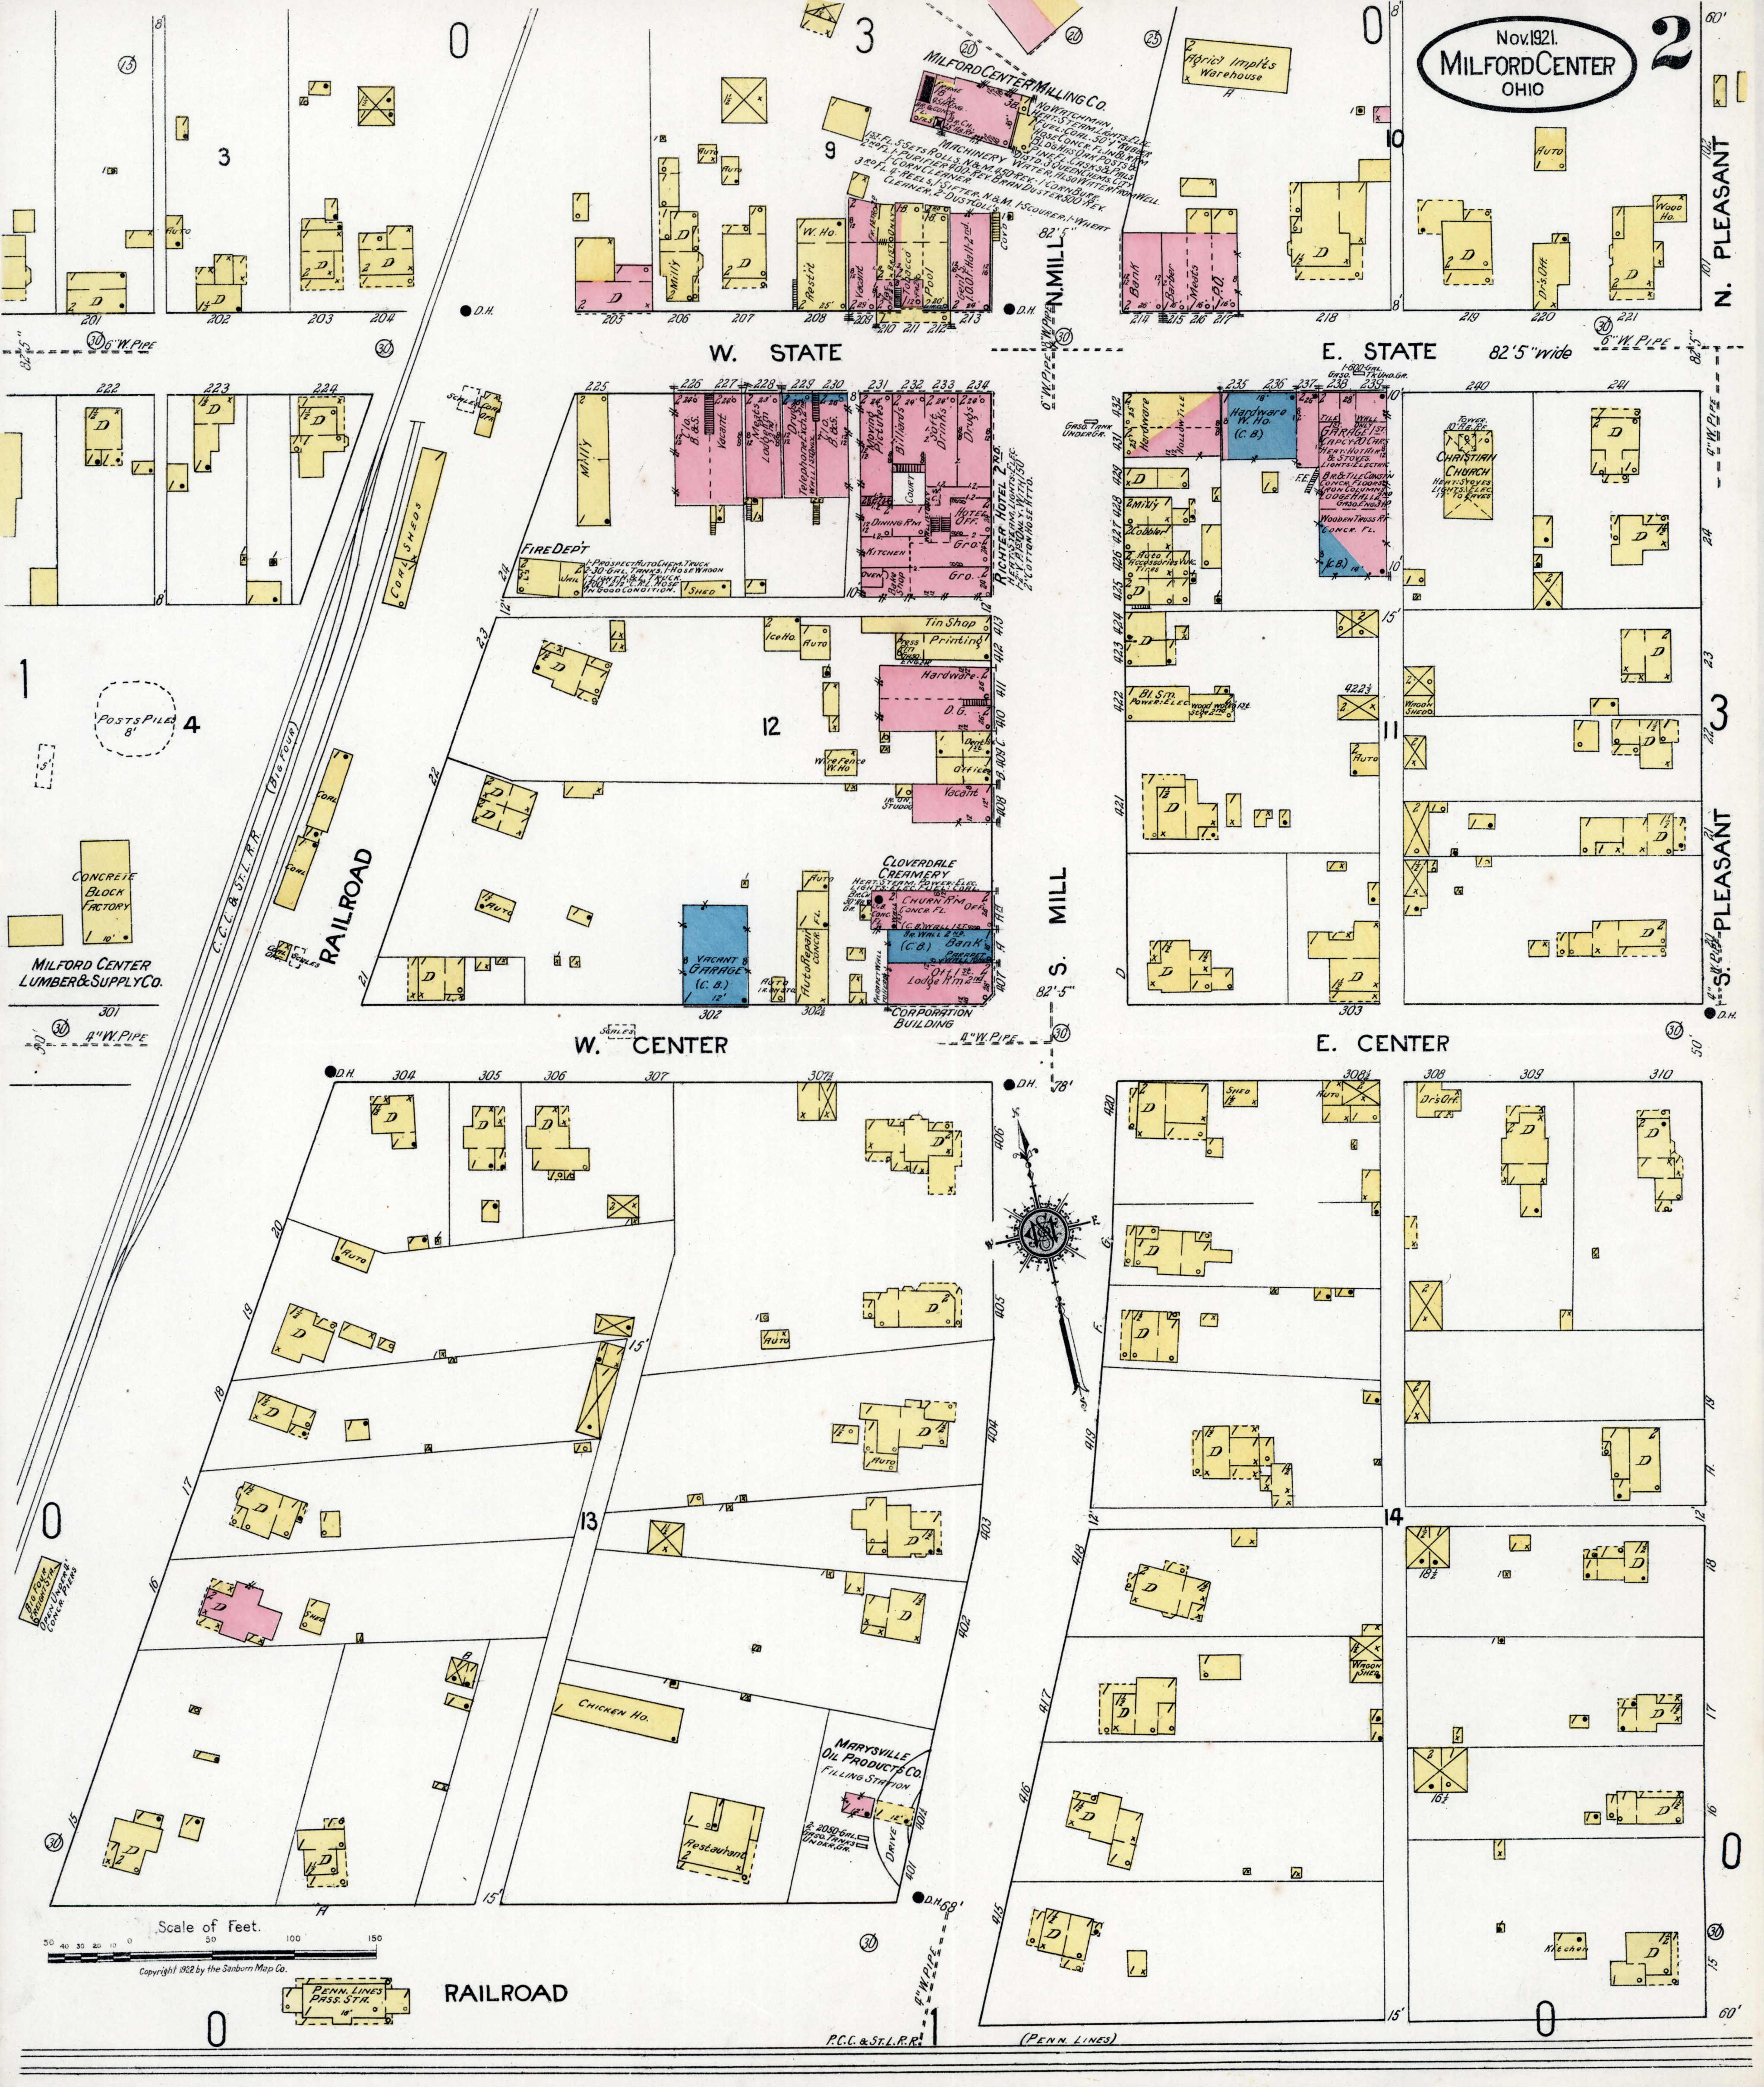

Scale of Feet.
0 50 100 150

Copyright 1922 by the Sanborn Map Co.

PENN. LINES
PASS. STN.

RAILROAD

P.C.C. & S.T.L. R.R.

(PENN. LINES)

Nov. 1921.
MILFORD CENTER
OHIO

